



PURCHASING SECTION
6645 – 148th Street, Surrey, B.C. V3S 3C7
Tel: 604-590-7274 Fax: 604-599-0956
E-mail: purchasing@surrey.ca

ADDENDUM No. 1

REQUEST FOR QUOTATIONS (RFQ) NO.: 1220-040-2013-026

TITLE: REPLACE BOILER AT SURREY ARTS CENTRE

ADDENDUM ISSUE DATE: MAY 6, 2013

DATE: PREFER TO RECEIVE QUOTATIONS ON OR BEFORE MAY 15, 2013

INFORMATION FOR CONTRACTORS

This Addendum is issued to provide additional information and clarifications to the RFQ for the above named project, to the extent referenced and shall become a part thereof. No consideration will be allowed for extras due to the contractor not being familiar with this addendum. This Addendum No. 1 contains two (2) pages in total.

REFER TO CONTRACT DRAWINGS, MECHANICAL

1. DRAWING NO. M2.01

REVISE:


Boiler B-1 & B-2 supply and return piping to connect to low loss header individually.

2. DRAWING NO. M2.02

ADD:

Low Loss Header Detail. Refer to sketch MADD-1.1.

FOR VERTICAL HEADER INSTALLATION,
ENSURE THAT THE AAV IS POINTED UP
& DRAIN DISCHARGE IS POINTED DOWN.

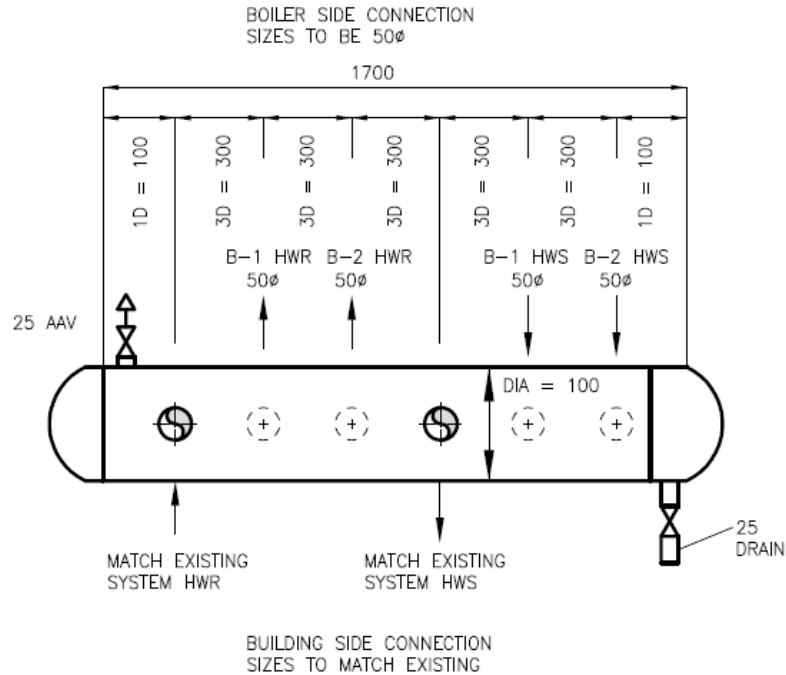

4
M2.02

LOW LOSS HEADER DETAIL

SCALE: N.T.S.

THIS SKETCH IS TO BE USED IN CONJUNCTION WITH DRAWING: M2.02

<p>AME Group Consulting Professional Engineers</p> <p><small>VANCOUVER T. (604) 684-5995 F. (604) 484-5993 501 - 134 ABBOTT STREET VANCOUVER, BC V6B 2E4</small></p> <p><small>VICTORIA T. (250) 382-5999 F. (250) 382-5998 721 JOHNSON STREET VICTORIA, BC V8W 1M5</small></p>	PROJECT TITLE: SURREY ARTS CENTRE - BOILER REPLACEMENT		DRAWING TITLE: LOW LOSS HEADER DETAIL	
	DRAWN BY J. CHUNG	CHECKED BY A. OZATA	SCALE N.T.S.	DATE MAY 1, 2013
COPYRIGHT RESERVED This drawing and design is the property of the designer to be used only for the project named below. This page or any portion thereof shall only be reproduced with express written permission.		PROJECT NO. 085b-023-12	DRAWING NO. MADD-1.1	

END OF ADDENDUM

All Addenda will become part of the RFQ Documents.